


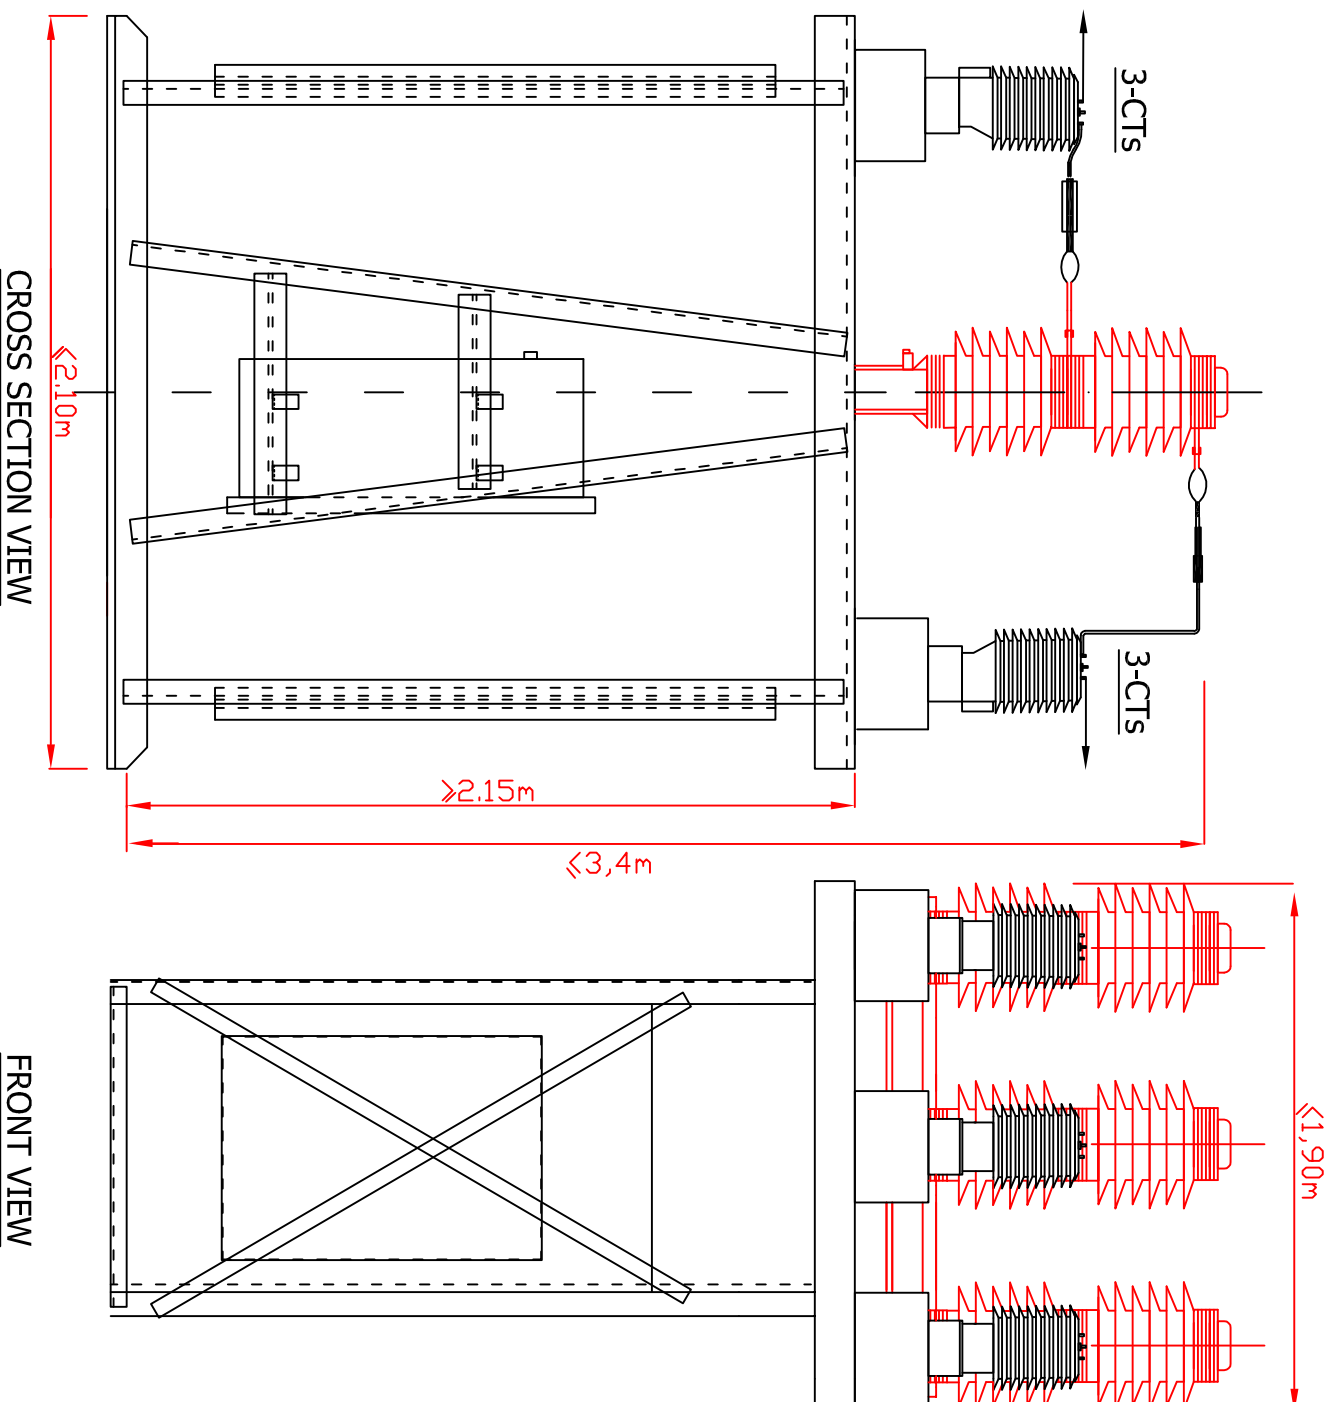

Notes

1. The minimum distance of the lower live point (lower end of porcelain) both of the circuit breaker and the CTs to the concrete base, must be $\geq 2250mm$.
The height of the lower conductor from the concrete base must be $\geq 2550mm$.
2. All indicated dimensions are mandatory. Deviations from these dimensions is sufficient reason for rejection of the offer.
3. The six (6) CTs, three on each side of the circuit breaker shall be of 1440-1900/0.58A ratio.

SK-CB/CT-3

Sketch of the steel structure arrangement for the combination of an outdoor, live tank circuit breaker and CTs for 20KV bus coupling.